

# Measurements of Cavitation Compliance in the Draft Tube Cone of a Reduced Scale Francis Turbine Operating at Part Load

<sup>1</sup>João Gomes P. Jr.\*; <sup>1</sup>Arthur Favrel; <sup>2</sup>Christian Landry, <sup>2</sup>Christophe Nicolet; <sup>1</sup>François Avellan;

<sup>1</sup>*École Polytechnique Fédérale de Lausanne, Lausanne, VD, Switzerland;* <sup>2</sup>*Power Vision Engineering Sàrl, Ecublens, VD, Switzerland*

## Abstract

Francis turbines operating at part load conditions typically experience a cavitation vortex rope immediately at the runner outlet. As the compliance of this cavitation flow is much higher than the one in cavitation-free conditions, a decrease in the value of the eigen frequencies of the hydraulic circuit is observed. One of the eigen frequencies can eventually match the frequency of the vortex precession, which acts as an excitation source for the hydraulic system, inducing strong pressure pulsations and output power swings. To predict such undesirable resonance conditions in hydropower plants, the cavitation compliance in the draft tube cone can be identified beforehand at the model scale. This paper presents the identification of the cavitation compliance on a reduced scale model of a Francis turbine over a wide range of part load operating conditions, for different Thoma and Froude numbers. The first eigen frequency of the test rig is firstly identified by modal analysis. The cavitation compliance is then defined by adjusting a 1-D numerical model of the test rig to match this first eigen frequency. These compliance results could then be transposed to the prototype scale, enabling the prediction of the first eigen frequency of the hydropower plant in any part load condition.

**Keywords:** Cavitation vortex rope; resonance; Francis turbine; hydro-acoustic model; cavitation compliance; pressure pulsations

## Introduction

At off-design conditions, Francis turbines experience the development of a swirling flow in the draft tube, which intensity depends mainly on the value of the flow discharge. At part load conditions, with a discharge ranging usually from about 50 % to 90 % of the rated value, a vortex breakdown arises immediately at the runner outlet and produces a flow recirculation zone in the draft tube, accompanied by a helical cavitation vortex rope.

The precession of this vortex acts as a pressure excitation source for the system, leading to the propagation of synchronous pressure pulsations in all the hydraulic circuit [1]. Further consequence of the cavitation vortex development is the strong impact on the eigen frequencies of the hydraulic circuit, as it increases the flow compliance inside the draft tube [2]. One of these eigen frequency values may match the frequency of the synchronous pressure pulsations, causing resonance phenomena and potentially electrical output power swings of the generating unit [3]. To predict these undesirable resonance conditions at the prototype scale, the hydro-acoustic parameters describing the draft tube cavitation flow in transient 1-D numerical simulations must be known. They can be determined by performing hydro-acoustic modal analysis of a test rig facility containing the reduced scale physical model of the Francis turbine prototype operating in similar conditions. Once the experimental eigen frequencies of the test rig are known, the parameters of the 1-D hydro-acoustic numerical model of the test rig, including the draft tube cavitation flow, can be adjusted to match the measurements [4].

In this paper, the hydro-acoustic parameters of the hydraulic circuit are initially adjusted by the experimental results obtained in cavitation-free conditions. Measurements are then performed at part load conditions, for which the cavitation vortex rope is experienced. The compliance of the draft tube cavitation flow is then modified in the 1-D numerical model to match the experiments, while the hydro-acoustic parameters of the other parts of the test rig remains unchanged. Finally, the obtained values of cavitation compliance are presented and comparisons are made between different IEC speed and discharge factors,  $n_{ED}$  and  $Q_{ED}$  respectively, and Thoma and Froude numbers,  $\sigma$  and  $Fr$  respectively (definition of these factors and numbers can be found in [5]). The possibility of using the swirl number  $S$  to reduce the number of measurements at different  $n_{ED}$  values is then analyzed and discussed.

\*Corresponding Author, João Gomes P. Jr.: [joao.gomes@epfl.ch](mailto:joao.gomes@epfl.ch)

### Resonance in part load conditions

For a given longitudinal position  $x$  along the draft tube cone center-line, the local plane wave speed  $a$  can be calculated as in Equation (1). The variable  $C_{eq}$  represents the equivalent compliance of the draft tube, including the cavitation vortex, the water and the pipe, as presented in Equation (2). The cavitation compliance  $C_c$  is defined in Equation (3), [6].

$$a(x) = \sqrt{\frac{gA_p(x)dx}{C_{eq}(x)}} \quad (1)$$

$$C_{eq} = C_c + C_{water} + C_{pipe} \quad (2)$$

$$C_c(x) = -\frac{\partial V_c(x)}{\partial h} = -dx \frac{\partial A_c(x)}{\partial h} \quad (3)$$

where  $g$  is the local gravity,  $A_p$  is the pipe cross-section,  $A_c$  is the cavitation vortex cross section and  $h$  is the piezometric head.

Equation (1) implies that higher values of  $C_{eq}$  lead to lower wave speeds. As the wave speed in cavitation conditions is much smaller than the one in cavitation-free conditions, the approximation  $C_{eq} \approx C_c$  can be made. Consequently, the cavitation compliance becomes the most important factor determining the wave speed that, in its turn, will have a major impact on the value of test rig eigen frequencies.

In Figure 1(a), the influence of the cavitation Thoma number on both the first eigen frequency of the test rig and the vortex rope frequency is presented. The influence of the discharge factor on both frequency values is given in Figure 1(b). For the conditions presented in this figure, the vortex rope frequency remained approximately constant for any  $\sigma$  and presented a small decrease with the increase in  $Q_{ED}$ . Furthermore the first eigen frequency of the test rig presents an important decrease for both lower  $\sigma$  and  $Q_{ED}$  values. In both cases, resonance occurs when the first eigen frequency of the test rig and the precession frequency of the vortex match, notably for  $\sigma = 0.112$  and  $Q_{ED} = 0.303$  in the shown test cases.

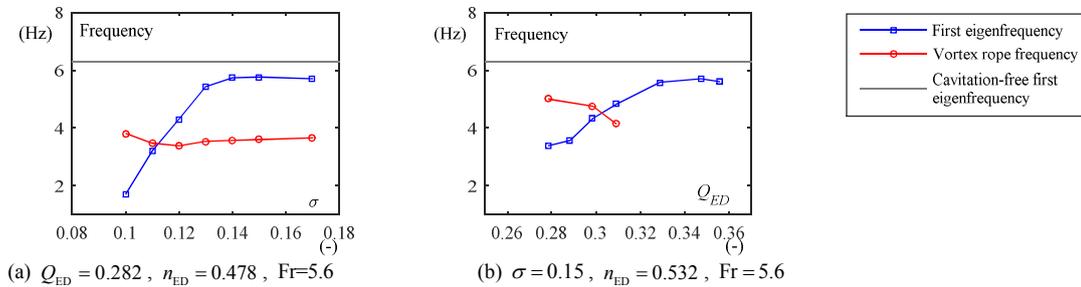


Figure 1 – Influence of the Thoma number (a) and discharge factor (b) on both the first eigen frequency of the test rig and the vortex rope frequency.

### Experimental setup and cavitation compliance determination

The methodology to determine the first eigen frequency and the cavitation compliance  $C_c$  is similar to the one described by Landry et al. in [4]. For the present study, the two 400 kW centrifugal pumps are installed in parallel and the test case is a reduced scale model of a Francis turbine with specific speed  $N_{QE} = 0.28$  and a reference diameter  $D = 0.35\text{m}$ .

An external excitation system is used to identify the first eigen frequency of the test rig. It consists of a rotating valve that is installed connecting one pipe at the turbine upstream pipe to a high-pressure reservoir, allowing the injection of periodical fluctuations at a given frequency into the test rig. By using pressure sensors installed along the hydraulic circuit, the first eigen frequency is identified as being the frequency leading to the maximum response.

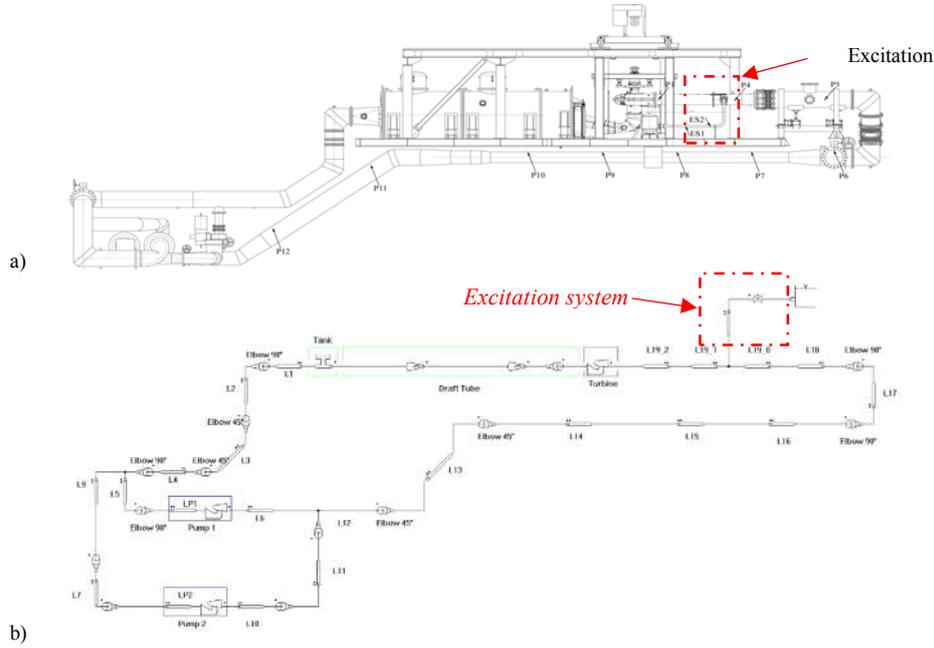


Figure 2 – Complete test rig and excitation system experimental setup (a) and the 1-D numerical model (b).

The compliance and bulk viscosity values of the test rig pipes are first identified by adjusting their values in the 1-D numerical model to match the first eigen frequency and the system response of the test rig obtained experimentally in a cavitation-free condition. The value of first eigen frequency in cavitation-free conditions is 6.28 Hz and is indicated by the grey line in Figure 1.

In cavitation conditions, a lower eigen frequency is made apparent and the cavitation compliance values in the first part of the draft tube of the numerical model is adjusted to obtain the same value of eigen frequency. The cavitation compliance is applied to the first one meter long ( $2.86 \times D$ ) upper part of the draft tube, starting from the runner outlet until the beginning of the draft tube elbow. The remaining parts of the draft tube (roughly half of the elbow and the diffuser), and the rest of the test rig keep the same compliance as in cavitation-free condition. The bulk viscosity remains unchanged and equal to 0.4818 MPa·s in the full circuit. More details on the 1-D model applied in this paper can be found in [6] and [7]. General aspects and discussions on modeling the cavitation compliance can be found in [8].

The investigated operating conditions are summarized in Table 1. Firstly, it presents the cavitation-free operating condition used to calibrate the model. Secondly, it presents the tests where the influence on the discharge factor variation is focused. These tests are made for a combination of two values of Thoma number,  $\sigma_{\min}$  and  $\sigma_{\max}$ , two Froude numbers, and five different speed factors. The two Thoma numbers,  $\sigma_{\min}$  and  $\sigma_{\max}$ , are defined using a similar approach to the one adopted in [9]. The last line of Table 1 presents additional measurements focused on the effects of the Thoma number variation on the cavitation compliance.

### Swirl number

The swirl number  $S$  is defined as the ratio between the axial flux of angular momentum and the axial flux of axial momentum and was originally proposed by Gupta et al. [10]. As the swirl intensity and the cavitation compliance in a vortex rope are strongly related, Favrel et al. proposed Equation (4) for the calculation of the swirl number at the Francis turbines outlet [9]. As presented in [9], points with similar  $\sigma$ , same Froude number and varying  $n_{ED}$  presented resonance conditions when operating at the same swirl number.

$$S = n_{ED} \frac{\pi^2}{8} \left( \frac{1}{Q_{ED}} - \frac{1}{Q_{ED}^{S=0}} \right) \quad (4)$$

Table 1 – Tested operating conditions

	Fr (-)	$n_{ED}$ (-)	$Q_{ED}$ (-)	$\sigma$ (-)
Cavitation-free test	5.6	0.478	0.282	0.917
$Q_{ED}$ variation tests	5.6 and 7.10	0.457	0.183 → 0.287	$\sigma_{min} = 0.110$ and $\sigma_{max} = 0.128$
		0.478	0.204 → 0.322	$\sigma_{min} = 0.120$ and $\sigma_{max} = 0.140$
		0.506	0.229 → 0.314	$\sigma_{min} = 0.134$ and $\sigma_{max} = 0.157$
		0.532	0.245 → 0.356	$\sigma_{min} = 0.149$ and $\sigma_{max} = 0.174$
$\sigma$ variation tests	5.6	0.478	0.220 and 0.282	0.10 → 0.17

### Measurements results and discussion

The first eigen frequency measured on the test rig and the average wave speed in the draft tube cone as a function of the cavitation compliance are presented in Figure 3. The relation between  $C_c$  and the first eigen frequency is provided by the 1-D numerical model and the local wave speed is calculated as in Equation (1). The graph contains all the operating conditions described in the Table 1. With the exception of the result in cavitation-free condition, all the eigen frequency data collapses into one single curve, regardless of variations in discharge, rotation speed, Froude and Thoma numbers. The presented average wave speed values are below 50 m/s, far lower than the value in cavitation-free conditions, for which a wave speed above 750 m/s is expected.

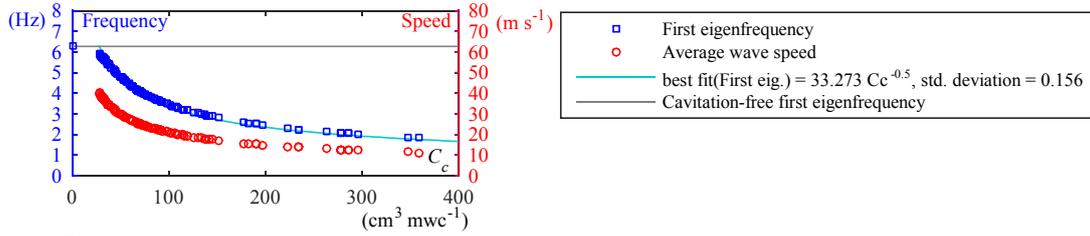


Figure 3 – First eigen frequency of the test rig and mean wave speed as a function of the cavitation compliance.

In Figure 4, the influence of the discharge factor (Figure 4(a)) and the swirl number (Figure 4(b)) on the value of  $C_c$  is presented for four different  $n_{ED}$  values with  $Fr = 5.6$  and  $\sigma = \sigma_{min}$ . While using the swirl number instead of  $Q_{ED}$ , with the exception for  $n_{ED} = 0.457$ , the measurements are slightly better collapsed into a single curve. This deviation for  $n_{ED} = 0.457$  may be related to the presence of inter-blade vortices, expected to be more intense for this speed factor. Even though this type of cavitation is not developing in the draft tube cone, it affects the value of the first eigen frequency and is then assimilated by the numerical model into the value of cavitation compliance in the draft tube.

The value of  $C_c$  tends to grow exponentially with an increase in the value of the swirl number. For each tested  $n_{ED}$  value, measurements are performed until a  $Q_{ED}$  value for which the cavitation vortex dynamics lose its coherence and the first eigen frequency cannot be determined accurately. This phenomenon is discussed in more details in [9].

Figure 5 presents the cavitation compliance as a function of the swirl number for different values of  $\sigma$ . The speed factor and the Froude number are kept constant ( $n_{ED} = 0.478$ ,  $Fr = 5.6$ ). As expected, smaller values of  $\sigma$  are characterized by higher values of cavitation compliance. The cavitation compliance increases exponentially with the decrease in  $\sigma$ , explaining the sharp drop in the first eigen frequency shown in Figure 1(a) for low  $\sigma$  values. It can also be noticed that  $\sigma$  has a greater influence on  $C_c$  as the swirl increases.

The effect of the Froude number is presented in Figure 6 and Figure 7. The influence of the Froude number on the cavitation compliance for  $\sigma_{min}$  and  $\sigma_{max}$  at  $n_{ED} = 0.506$  is given in Figure 6. It can be noticed that for higher swirl numbers, an increase in the value of Froude number tends to decrease the cavitation compliance. The same observation is made for all  $n_{ED}$  values in Figure 7 for  $\sigma_{min}$  and  $\sigma_{max}$ .

For all the  $\sigma$  values that were tested, this turbine presented inter-blade cavitation at the swirl free condition. For this reason, all the cavitation compliance curves remains slightly above zero even for very low swirl number values.

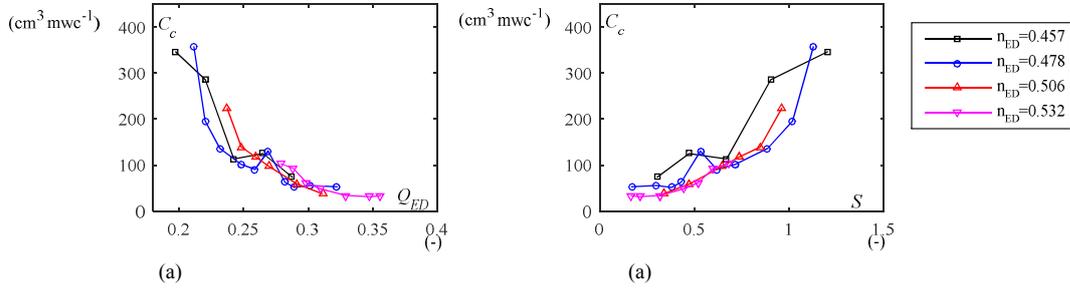


Figure 4 – Cavitation compliance for four different values of  $n_{ED}$  as a function of (a)  $Q_{ED}$  and (b) swirl number  $S$  for  $Fr = 5.6$  and  $\sigma = \sigma_{min}$ .

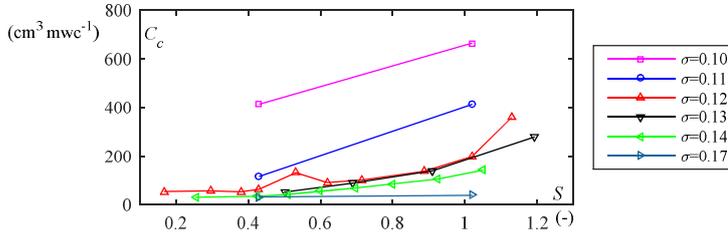


Figure 5 – Influence of  $\sigma$  on the cavitation compliance for a constant Froude number and  $n_{ED}$  value.

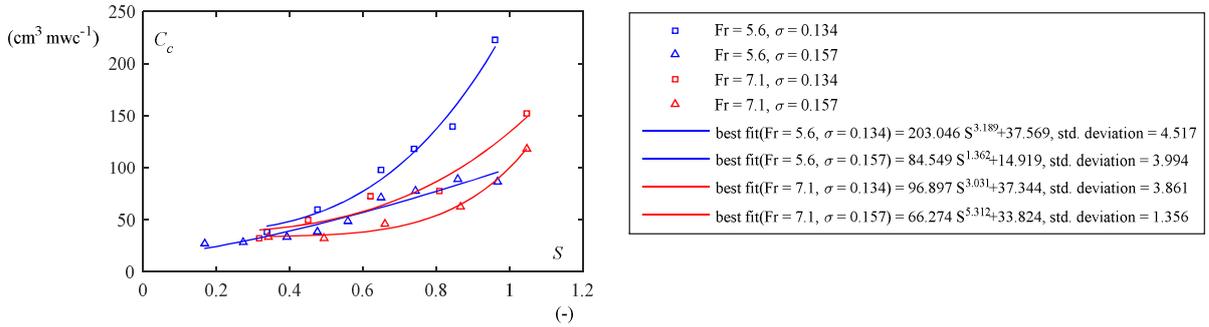


Figure 6 – Influence of Froude number and  $\sigma$  on the cavitation compliance for a constant  $n_{ED}$  value ( $n_{ED} = 0.506$ ).

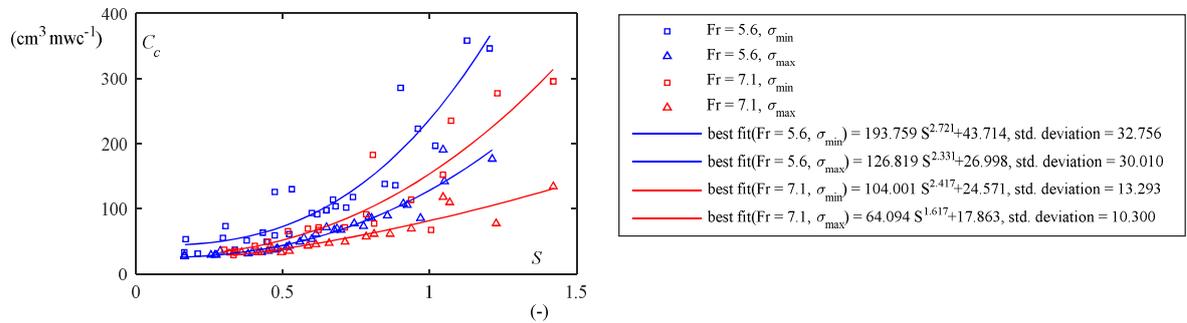


Figure 7 – Influence of the Froude number and  $\sigma$  on the cavitation compliance for all the tested  $n_{ED}$  values.

## Conclusion

This paper presents the results of measurements of the cavitation compliance in the draft tube cone of a Francis turbine model operating in part load conditions. The results are intended to improve the understanding of the influence of the operating parameters on the compliance, so that resonance conditions can be predicted in the future.

A simple relation between the eigen frequency and the cavitation compliance is first presented. A similar behavior is expected in a prototype hydraulic circuit. By performing measurements such as the one presented in this paper, combined with a proper transposition from model to prototype of the cavitation compliance, the first eigen frequency of the power plant can then be predicted for any part load operating condition.

Furthermore, the swirl number can be used to obtain a good overall tendency of the cavitation compliance behavior at different  $n_{ED}$  values. However, additional phenomena that do not depend directly on the swirl number, such as inter-blade cavitation vortices development, affect the calculated cavitation compliance, making the only use of the swirl number an approximate approach in certain cases.

Assuming a constant cavitation compliance located only in the upper part of the draft tube does not reflect the real size and evolution of the cavitation volume along the draft tube. In addition, other types of cavitation can develop in the runner. However, the proposed approach largely simplifies the comparison of the cavitation compliance between different operating points and, eventually, different turbine designs. The results presented in this paper can be quickly compared with measurements performed with other test cases. This methodology can in the future become a standard procedure during model testing for the assessment of risk of resonance in hydropower plant.

## Bibliography

- [1] J. Arpe, C. Nicolet and F. Avellan, "Experimental Evidence of Hydroacoustic Pressure Waves in a Francis Turbine Elbow Draft Tube for Low Discharge Conditions," *Journal of Fluids Engineering*, vol. 131, no. 8, pp. 081102-081102-9, 2009.
- [2] C. Brennen and A. J. Acosta, "The Dynamic Transfer Function for a Cavitating Inducer," *Journal of Fluids Engineering*, vol. 98, no. 2, pp. 182-191, 1976.
- [3] W. J. Rheingans, "Power Swings in Hydroelectric Power Plants," *Trans. ASME*, vol. 62, pp. 171-184, 1940.
- [4] C. Landry, A. Favrel, A. Müller, c. Nicolet and F. Avellan, "Local wave speed and bulk flow viscosity in Francis turbines at part load operation," *Journal of Hydraulic Research*, vol. 54, no. 2, pp. 185-196, 2016.
- [5] International Electrotechnical Commission, IEC 60193 - Hydraulic turbines, storage pumps and pump-turbines - Model acceptance tests, 2 ed., Geneva, 1999.
- [6] C. Landry, Hydroacoustic modeling of a cavitation vortex rope for a Francis turbine, Thèse n. 6547 ed., Lausanne: EPFL, 2015.
- [7] C. Nicolet, "Hydroacoustic modeling and numerical simulation of unsteady operation of hydroelectric systems," PhD Thesis number 3751, EPFL, Lausanne, Switzerland, 2007.
- [8] P. K. Dörfler, "Cavitation compliance in 1D part-load vortex models," *International Journal of Fluid Machinery and Systems*, vol. 10, no. 3, 2017.
- [9] A. Favrel, J. Gomes, C. Ladry, C. Nicolet, F. Avellan and A. Müller, "New insight in Francis turbine cavitation vortex rope: role of the runner outlet flow swirl number," *Journal of Hydraulic Research*, 2017.
- [10] A. K. Gupta, D. G. Lilley and N. Syred, Swirl flows, Trundbridge Wells, Kent: Abacus Press, 1984.